

FireLock™ High-Pressure Butterfly Valve

Series 765 with Weatherproof Actuator – Supervised Open



1.0 PRODUCT DESCRIPTION

Available Sizes

- 2 – 12"/DN50 – DN300

Pipe Material

- Carbon Steel, Schedule 10 and Schedule 40. For use with alternative materials, contact Victaulic.

Maximum Working Pressure

- Up to 365 psi/2517 kPa/25 Bar

Application

- High-pressure butterfly valve with an approved weatherproof actuator housing for indoor and outdoor use.
- Designed for fire protection services only.
- Designed to be supervised open.
- Exclusively for use with pipe and Victaulic products that feature ends formed with the Victaulic Original Groove System (OGS) groove profile (see Section [7.1 Reference Materials](#)).

Actuation Options

- Handwheel (2 – 12"/DN50 – DN300)

Available End Connections

- Victaulic Original Groove System (OGS)

2.0 CERTIFICATION/LISTINGS



G4090011



LPS 1185: Issue 3.1
Cert/LPCB Ref. 104j/02
846a/02



ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.



2.1 CERTIFICATIONS/LISTINGS

Size		Approval/Listing Service Pressures				
Nominal inches DN	Actual Outside Diameter inches mm	Series 765 Butterfly Valve				
		cULus psi kPa	FM psi kPa	VdS psi kPa	LPCB psi kPa	CCC psi kPa
2 DN50	2.375 60.3	365 2517	365 2517	365 2517	365 2517	363 2500
2½	2.875 73.0	365 2517	365 2517	–	365 2517	–
DN65	3.000 76.1	365 2517	365 2517	365 2517	365 2517	363 2500
3 DN80	3.500 88.9	365 2517	365 2517	365 2517	365 2517	363 2500
	4.250 108.0	365 2517	365 2517	–	365 2517	–
4 DN100	4.500 114.3	365 2517	365 2517	365 2517	365 2517	363 2500
	5.250 133.0	365 2517	365 2517	–	365 2517	–
DN125	5.500 139.7	365 2517	365 2517	365 2517	365 2517	–
5	5.563 141.3	365 2517	365 2517	–	365 2517	–
	6.250 159.0	365 2517	365 2517	–	365 2517	–
	6.500 165.1	365 2517	365 2517	–	365 2517	363 2500
6 DN150	6.625 168.3	365 2517	365 2517	365 2517	365 2517	–
8 DN200	8.625 219.1	365 2517	365 2517	365 2517	365 2517	363 2500
10 DN250	10.750 273.0	365 2517	300 2068	–	365 2517	363 2500
12 DN300	12.750 323.9	365 2517	300 2068	–	365 2517	–

3.0 SPECIFICATIONS – MATERIAL

Body: Ductile iron conforming to ASTM A536, Grade 65-45-12.

End Face, 2 – 6"/DN50 – DN150: Ductile iron conforming to ASTM A536, Grade 65-45-12

Seal Retainer, 8 – 12"/DN200 – DN300: Ductile iron conforming to ASTM A536, Grade 65-45-12

Body Coating: Black alkyd enamel

Disc: Ductile iron conforming to ASTM A536, Grade 65-45-12, with electroless nickel coating conforming to ASTM B733

Seat: EPDM

Stems: 416 stainless steel conforming to ASTM A582

Stem Seal Cartridge: C36000 brass

Bearings: Stainless steel with TFE lining

Stem Seals: EPDM


Stem Retaining Ring: Carbon steel

Actuator:

- 2 – 8"/DN50 – DN200: Bronze traveling nut on a steel lead screw, in a ductile iron housing
- 10 – 12"/DN250 – DN300: Steel worm and cast iron quadrant gear, in a cast iron housing

4.0 DIMENSIONS

Series 765

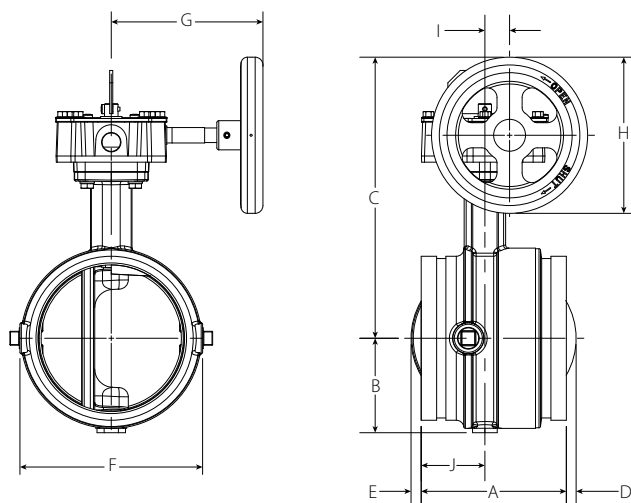

Size		Dimensions										Approx. Weight (Each)
Nominal inches DN	Actual Outside Diameter inches mm	A inches mm	B inches mm	C inches mm	D inches mm	E inches mm	F inches mm	G inches mm	H inches mm	I inches mm	J inches mm	
2	2.375	4.25	2.28	6.41	—	—	4.00	4.22	4.50	0.68	2.12	8.2
DN50	60.3	108	58	163	—	—	102	107	114	17	54	3.7
2 ½	2.875	3.77	2.28	7.54	—	—	4.00	4.22	4.50	0.68	1.77	9.7
	73.0	96	58	192	—	—	102	107	114	17	45	4.4
DN65	3.000	3.77	2.28	7.54	—	—	4.00	4.22	4.50	0.68	1.77	9.7
	76.1	96	58	192	—	—	102	107	114	17	45	4.4
3	3.500	3.77	2.53	7.79	—	—	4.50	4.22	4.50	0.68	1.77	10.7
DN80	88.9	96	64	198	—	—	114	107	114	17	45	4.9
	4.250	4.63	2.88	8.81	—	—	5.50	4.22	4.50	0.68	2.20	14.0
	108.0	118	73	224	—	—	140	107	114	17	56	6.4
4	4.500	4.63	2.88	8.81	—	—	5.50	4.22	4.50	0.68	2.20	14.0
DN100	114.3	118	73	224	—	—	140	107	114	17	56	6.4
	5.250	5.88	3.35	10.88	—	—	6.56	6.19	6.30	1.00	2.58	25.4
	133.0	149	85	276	—	—	167	157	160	25	66	11.5
DN125	5.500	5.88	3.35	10.88	—	—	6.56	6.19	6.30	1.00	2.58	25.4
	139.7	149	85	276	—	—	167	157	160	25	66	11.5
5	5.563	5.88	3.35	10.88	—	—	6.56	6.19	6.30	1.00	2.58	25.4
	141.3	149	85	276	—	—	167	157	160	25	66	11.5
	6.250	5.88	3.84	11.38	—	0.41	7.52	6.19	6.30	1.00	2.58	28.7
	159.0	149	98	289	—	10	191	157	160	25	66	13.0
	6.500	5.88	3.84	11.38	—	0.41	7.52	6.19	6.30	1.00	2.58	28.7
	165.1	149	98	289	—	10	191	157	160	25	66	13.0
6	6.625	5.88	3.84	11.38	—	0.41	7.52	6.19	6.30	1.00	2.58	28.7
DN150	168.3	149	98	289	—	10	191	157	160	25	66	13.0
8	8.625	5.33	5.07	13.53	0.80	1.47	10.00	6.19	8.10	1.00	2.33	43.0
DN200	219.1	135	129	344	20	37	254	157	206	25	59	19.5
10	10.750	6.40	6.37	15.64	1.41	1.81	12.25	8.10	11.81	2.71	3.00	80.6
DN250	273.0	163	162	397	36	46	311	206	300	69	76	36.6
12	12.750	6.50	7.36	16.64	2.30	2.80	14.25	8.10	11.81	2.71	3.00	94.6
DN300	323.9	165	187	423	58	71	362	206	300	69	76	42.9

NOTE

- Optional ½"/15mm tap available for all sizes. Contact Victaulic for details.

5.0 PERFORMANCE

Series 765

This table expresses the frictional resistance of a Series 765 High-Pressure Butterfly Valve in equivalent feet/meters of straight pipe.

Size		Equivalent Feet/m of pipe
Nominal inches DN	Actual Outside Diameter inches mm	
2 DN50	2.375 60.3	6 1.8
2½	2.875 73.0	6 1.8
DN65	3.000 76.1	6 1.8
3 DN80	3.500 88.9	7 2.1
	4.250 108.0	8 2.4
4 DN100	4.500 114.3	8 2.4
	5.250 133.0	12 3.7
DN125	5.500 139.7	12 3.7
5	5.563 141.3	12 3.7
	6.250 159.0	14 4.3
	6.500 165.1	14 4.3
6 DN150	6.625 168.3	14 4.3
8 DN200	8.625 219.1	16 4.9
10 DN250	10.750 273.0	18 5.5
12 DN300	12.750 323.9	19 5.8

5.1 PERFORMANCE

Series 765

C_v values for flow of water at +60°F/+16°C through a fully open valve are shown in the table below. For additional details, contact Victaulic.

Formulas for C_v Values:

$$\Delta P = \frac{Q^2}{C_v^2}$$

$$Q = C_v \times \sqrt{\Delta P}$$

Where:

Q = Flow (GPM)

ΔP = Pressure Drop (psi)

C_v = Flow Coefficient

Formulas for K_v Values:

$$\Delta P = \frac{Q^2}{K_v^2}$$

$$Q = K_v \times \sqrt{\Delta P}$$

Where:

Q = Flow (m³/hr)

ΔP = Pressure Drop (Bar)

K_v = Flow Coefficient

Size		Flow Coefficient
Nominal inches mm	Actual Outside Diameter inches mm	Full Open C _v K _v
2	2.375	170
DN50	60.3	147
2½	2.875	260
	73.0	225
DN65	3.000	260
	76.1	225
3	3.500	440
DN80	88.9	380
	4.250	820
	108.0	710
4	4.500	820
DN100	114.3	710
	5.250	1200
	133.0	1040
DN125	5.500	1200
	139.7	1040
5	5.563	1200
	141.3	1040
	6.250	1800
	159.0	1560
	6.500	1800
	165.1	1560
6	6.625	1800
DN150	168.3	1560
8	8.625	3400
DN200	219.1	2940
10	10.750	5800
DN250	273.0	5020
12	12.750	9000
DN300	323.9	7790

6.0 NOTIFICATIONS

⚠ WARNING



- Read and understand all instructions before attempting to install any Victaulic products.
 - Always verify that the piping system has been completely depressurized and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products.
 - Confirm that any equipment, branch lines, or sections of piping that may have been isolated for/during testing or due to valve closures/positioning are identified, depressurized, and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products.
 - Wear safety glasses, hardhat, and foot protection.
- Failure to follow these instructions could result in death or serious personal injury and property damage.

- These products shall be used only in fire protection systems that are designed and installed in accordance with current, applicable National Fire Protection Association (NFPA) standards, or equivalent standards, and in accordance with applicable building and fire codes. These standards and codes contain important information regarding protection of systems from freezing temperatures, corrosion, mechanical damage, etc.
- The installer shall understand the use of this product and why it was specified for the particular application.
- The installer shall understand common industry safety standards and potential consequences of improper product installation.
- It is the system designer's responsibility to verify suitability of materials for use with the intended fluid media within the piping system and external environment.
- The material specifier shall evaluate the effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on materials to confirm system life will be acceptable for the intended service.

Failure to follow installation requirements and local and national codes and standards could compromise system integrity or cause system failure, resulting in death or serious personal injury and property damage.

7.0 REFERENCE MATERIALS


Switch and Wiring

- The supervisory switch contains two single-pole, double-throw, pre-wired switches.
- Switches are rated:
10 amps @ 125 or 250 VAC/60 Hz
0.50 amps @ 125 VDC
0.25 amps @ 250 VDC
- **Switches only supervise the valve in the "fully opened" position. The valve cannot be supervised in the "closed" position.**
- One switch has two #18 insulated wires per terminal, which permit complete supervision of leads (refer to diagrams and notes on this page). The second switch has one #18 insulated wire per terminal. This double circuit provides flexibility to operate two electrical devices at separate locations, such as an indicating light and an audible alarm, in the area that the valve is installed.
- A #14 insulated ground lead (green with yellow stripe) is provided. **NOTE:** The ground lead for older valve configurations may be solid green.

Switch #1 = S1 For connection to the supervisory circuit of a UL Listed alarm control panel – The switch is open when the valve is in the "fully opened" position

Switch #2 = S2 Auxiliary switch that may be connected to auxiliary devices, per the authority having jurisdiction

- | | | |
|----|---|--|
| S1 | { | Normally Closed Contact: (2) Blue |
| | | Common Contact: (2) Yellow |
| S2 | { | Normally Closed Contact: Blue with Orange Stripe |
| | | Normally Open Contact: Brown with Orange Stripe |
| | | Common Contact: Yellow with Orange Stripe |

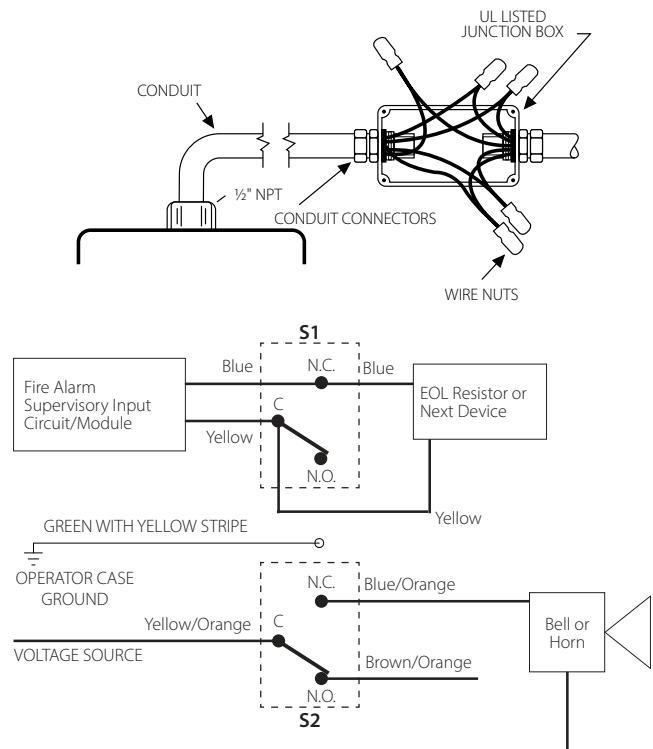

Switch contacts shown with the valve in the "FULLY OPENED" position

Only S1 (two leads per terminal) may be connected to the fire alarm control panel.

Connection of supervisory and auxiliary switches shall be in accordance with applicable sections of NFPA 72 and NFPA 70 (NEC).

7.1 REFERENCE MATERIALS

- [10.01: Regulatory Approval Reference Guide](#)
- [10.75: FireLock™ Butterfly Valve Series 707C with Weatherproof Actuator – Supervised Closed](#)
- [10.81: FireLock™ Butterfly Valve Series 705 with Weatherproof Actuator – Supervised Open](#)
- [10.83: FireLock™ High-Pressure Butterfly Valve Series 766 with Weatherproof Actuator – Supervised Closed](#)
- [25.01: Original Groove System \(OGS\) Groove Specifications](#)
- [29.01: Terms and Conditions/Warranty](#)
- [I-100: Field Installation Handbook](#)
- [I-765/705: Series 765 and 705 Installation, Wiring, and Gear Operator Replacement Instructions](#)
- [I-766/707C: Series 766 and 707C Installation, Wiring, and Gear Operator Replacement Instructions](#)

User Responsibility for Product Selection and Suitability

Each user bears final responsibility for determining the suitability of Victaulic products for their end-use application, in accordance with industry standards, project specifications, and Victaulic's published performance, maintenance, and safety data, as well as all warnings and installation instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, warranty, installation instructions, or this disclaimer.

Installation

Always refer to and follow the [Victaulic Installation Handbook](#) or installation instructions for the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at victaulic.com.

Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

Intellectual Property Rights

No statement concerning the use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its affiliates, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries. Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.

Note

All products bearing a Victaulic trademark are manufactured by Victaulic or to Victaulic specifications. All products are to be installed only in accordance with the applicable Victaulic installation instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.